



PANDI WATER DISTRICT

M.G Santos St., Poblacion, Pandi, Bulacan 3014

Contact Nos. (0997)2536220 / (0942)9807556/ (044) 661-1050

Email: pandiwaterdistrict@yahoo.com Website: www.pandiwaterdistrict.com

SUPPLEMENTAL BID BULLETIN NOTICE TO BIDDERS

Bidders are hereby respectfully informed of the amendments, revisions, modifications and clarifications to the Bidding Documents of the Public Bidding of the Supply, Delivery and Installation 15HP Pump Set, Ø 100mm Discharge Piping and 50 KVA (1-Phase) Generator Set at Brgy. Malibong Matanda, Pandi, Bulacan that was posted in the PhilGEPs and PanWaDis Website.

In compliance with the Revised Implementing Rules and Regulations of RA 9184, the information provide for shall form an integral part of the pertinent Bidding Documents and related Contact. Further, acknowledgement and receipt of this supplemental bid bulletin shall bound the bidder/s of the terms and conditions set forth, otherwise the nonconformity thereof may consider the bid as nonresponsive to the bidding policies. Consequently, the same may result in the disqualification and/or rejection of the concerned bidders Bid.

In any instance, receipt of this supplemental Bid Bulletin by the bidders presupposed that in the course of their preparation of their respective bids, they have understood and complied with the amendment and revised provisions and regulations expressed herein.

Accordingly, the immediate proceeding amendments and revisions are incorporated in the bidding documents:


A. Schedule or Requirements

| ORIGINAL | | AMENDED | |
|----------|---|---------|--|
| 6 | Riser Pipe, B.I, Seamless pipe, Super pipe, 100mm (4in.) | 6 | UPVC Riser Pipe 100mm dia. By 3m, Class B, Wall Thickness 8.5mm. 1 Set Stainless Steel Top/Bottom Adaptor 100mm. |
| 7 | Submersible Cable AWG #6 (14mm ²), 120m length. | 7 | Submersible Cable AWG #4 (14mm ²), 120m length. |


Done this December 11, 2020.

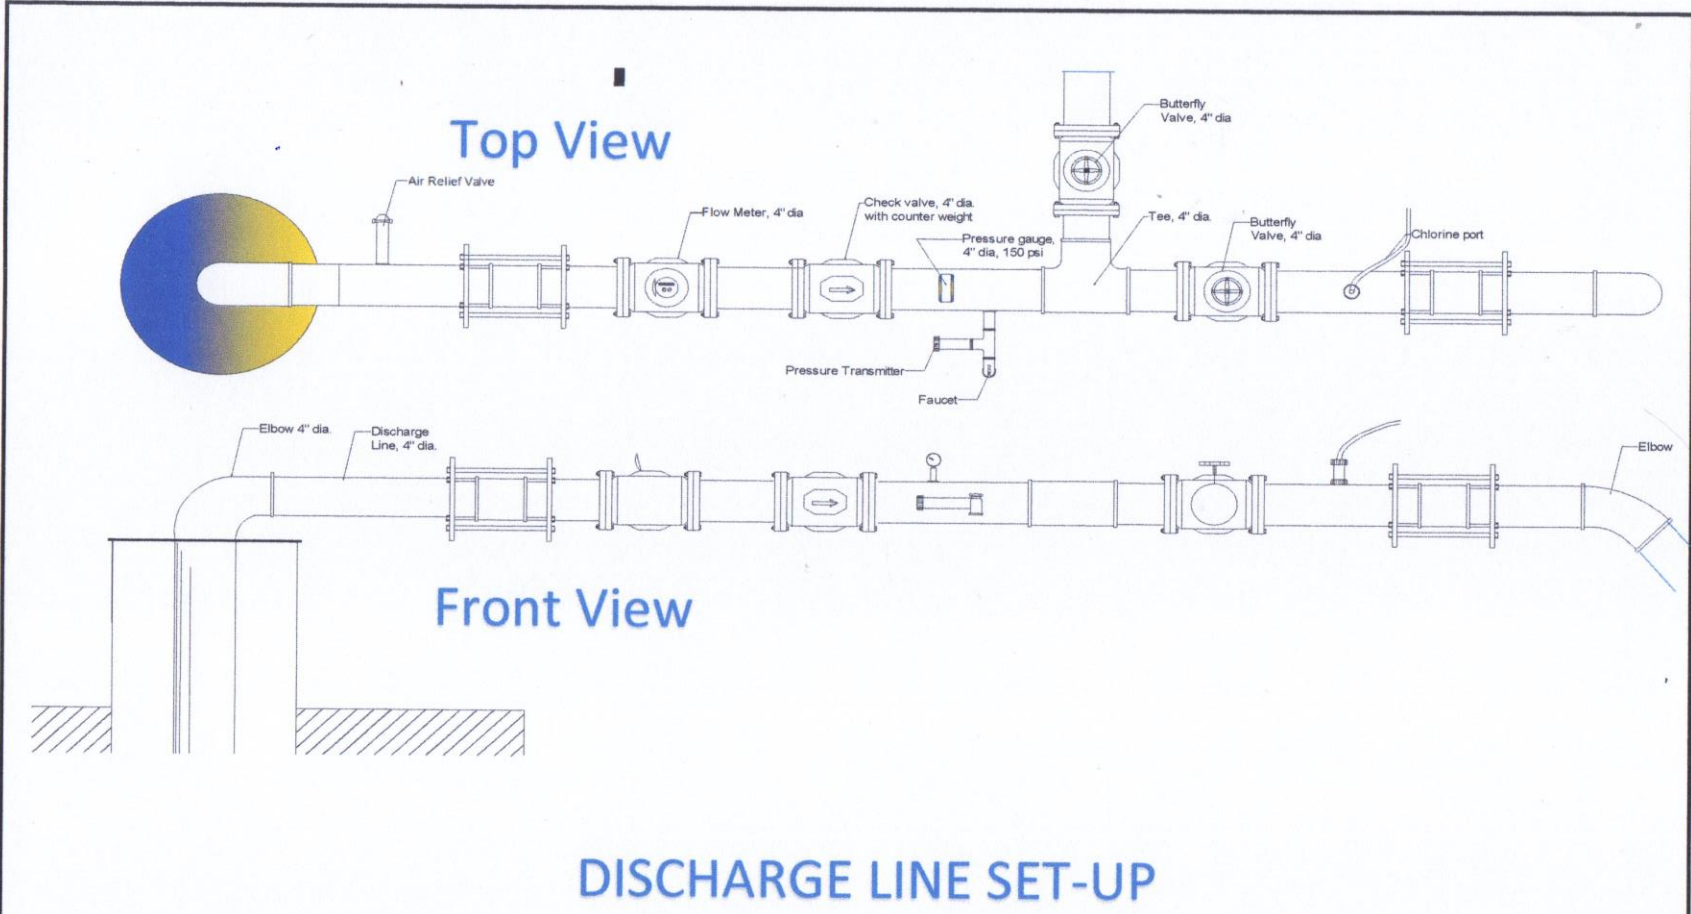
For your information and guidance.

Prepared by:


Trishialinn D.R. Armiza
BAC Secretariat

Approved by:


Engr. Cesar A. Ortega
BAC Chairperson



PANDI WATER DISTRICT
M.Santos St. Poblacion Pandi Bulacan

Title

PLANAST ST. MALIBO MATANDA DICHARGE LINE SET-UP

Date:

